

# Monitoring Relays

## True RMS 3-Phase, 3-Phase+N, Multifunction

### Types DPC01, PPC01

CARLO GAVAZZI



DPC01



PPC01

- TRMS 3-phase over and under voltage, phase sequence, phase loss and asymmetry monitoring relay
- Detect when all 3 phases are present and have the correct sequence
- Detect if all the 3-phase-phase or phase-neutral voltages are within the set limits
- Detect if asymmetry is below set value
- Separately adjustable setpoints
- Separately adjustable delay functions (0.1 to 30 s)
- Output: 2 x 8 A relay SPDT NE
- For mounting on DIN-rail in accordance with DIN/EN 50 022 (DPC01) or plug-in module (PPC01)
- 45 mm Euronorm housing (DPC01) or 36 mm plug-in module (PPC01)
- LED indication for relays, alarm and power supply ON


### Product Description

3-phase or 3-phase+neutral line voltage monitoring relay for phase sequence, phase loss, asymmetry, over and under voltage (separately adjustable set points) with built-in time delay function.

Supply ranges from 208 to 690 VAC covered by three multivoltage relays (ranges over 415 VAC only on the DIN-rail housing).

### Ordering key

**DPC 01 D M48**

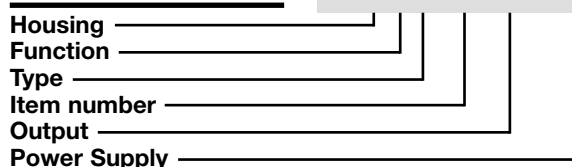

### Type Selection

Mounting	Output	Frequency	208 to 240 VAC	380 to 415 VAC	380 to 480 VAC	600 to 690 VAC
DIN-rail	2 x SPDT	50 - 60 Hz	<b>DPC 01 D M23</b>		<b>DPC 01 D M48</b>	<b>DPC 01 D M69</b>
DIN-rail	2 x SPDT	50 - 400 Hz	<b>DPC 01 D M23 400HZ</b>	<b>DPC 01 D M48 400HZ</b>		<b>DPC 01 D M69 440HZ</b>
Plug-in	2 x SPDT	50 - 60 Hz	<b>PPC 01 D M23</b>	<b>PPC 01 D M48</b>		

### Input Specifications

Input	Frequency	Terminals
L1, L2, L3, N	DPC01: 50 - 60 Hz PPC01: 50 - 400 Hz	Terminals L1, L2, L3, N Terminals 5, 6, 7, 11 Measure on own supply
Note: Connect the neutral only if it is intrinsically at the star centre		
Measuring ranges		
M23		177 to 275 ΔVAC
M48	DPC01	323 to 550 ΔVAC
	DPC01 440HZ	323 to 475 ΔVAC
	PPC01	323 to 475 ΔVAC
M69	DPC01	510 to 793 ΔVAC
Ranges		
Upper level		+2 to +22% of the nominal voltage
Lower level		-22 to -2% of the nominal voltage
Asymmetry		2 to 22% of the nominal voltage
Tolerance		2 to 22% of the nominal voltage
<b>Note:</b> The input voltage must not exceed the maximum rated voltage or drop below the minimum rated voltage reported above.		

### Output Specifications

<b>Output</b>	2 x SPDT relays N.E.
Rated insulation voltage	250 VAC
<b>Contact ratings (AgSnO<sub>2</sub>)</b>	μ
Resistive loads	AC 1 8 A @ 250 VAC DC 12 5 A @ 24 VDC
Small inductive loads	AC 15 2.5 A @ 250 VAC DC 13 2.5 A @ 24 VDC
<b>Mechanical life</b>	≥ 30 x 10 <sup>6</sup> operations
<b>Electrical life</b>	≥ 10 <sup>5</sup> operations (at 8 A, 250 V, cos φ = 1)
<b>Operating frequency</b>	≤ 7200 operations/h
<b>Dielectric strength</b>	
Dielectric voltage	≥ 2 kVAC (rms)
Rated impulse withstand volt.	4 kV (1.2/50 μs)

## Supply Specifications

<b>Power supply</b> Rated operational voltage through terminals: L1, L2, L3, N (DPC01) 5, 6, 7, 11 (PPC01) M23 - Delta Voltage: DPC01 M48 - Delta Voltage: DPC01 M48 - Star Voltage: PPC01 M48 - Delta Voltage: PPC01 M48 - Star Voltage: M48 400HZ - Delta Voltage: M48 400 HZ- Star Voltage: M69 - Delta Voltage: M69 - Star Voltage:	Overvoltage cat. III (IEC 60664, IEC 60038)  208 to 240VAC ±15%; 45 to 65Hz 380 to 480VAC ±15%;45 to 65Hz 220 to 277VAC ±15%;45 to 65Hz 380 to 415VAC ±15%;45 to 65Hz 220 to 240VAC ±15%;45 to 65Hz 380 to 415VAC ±15%;45 to 440Hz 220 to 240VAC ±15%;45 to 440Hz 600 to 690VAC ±15%;45 to 65Hz 347 to 400VAC ±15%;45 to 65Hz
---	--

<b>Rated operational power</b> M23 M48 M69	9 VA @ Δ230 VAC, 50 Hz 13 VA @ Δ400 VAC, 50 Hz 21 VA @ Δ600 VAC, 50 Hz Supplied by L2 and L3 for the DIN-rail versions and by L1 and L2 for the Plug-in versions
---	---

## General Specifications

<b>Power ON delay</b>	1 s ± 0.5 s or 6 s ± 0.5 s
<b>Accuracy</b> Temperature drift Delay ON alarm Repeatability	(15 min warm-up time) ± 1000 ppm/°C ± 10% on set value ± 50 ms ± 0.5% on full-scale

## Mode of Operation

Connected to the 3 phases (and neutral) DPC01 and PPC01 operate when all 3 phases are present at the same time and the phase sequence is correct. It can be decided whether to monitor upper and lower voltage level of each phase or their asymmetry and tolerance.

Asymmetry is defined as:

$$\frac{\max |\Delta V_{ph-ph}|}{\text{nom. voltage}}$$

when measuring phase-phase voltages and as:

$$\frac{\max |\Delta V_{ph-n}|}{\text{nom. voltage}}$$

when measuring phase-neutral voltages.

Tolerance is defined as:

$$\frac{\max |\text{Inom. voltage} - V_{ph-ph}|}{\text{nom. voltage}}$$

when measuring phase-phase voltages and as:

$$\frac{\max |\text{Inom. voltage} - V_{ph-n}|}{\text{nom. voltage}}$$

when measuring phase-neutral voltages.

**Voltage level monitoring:**

if one or more phase-phase or phase-neutral voltage exceed the upper set level or drop below the lower set level, the red LED starts flashing 2 Hz and the respective output relay releases after the set time period.

## General Specifications (cont.)

<b>Reaction time</b> Incorrect phase sequence or total phase loss Voltage level  Asymmetry level Alarm ON delay: Alarm OFF delay:	< 200 ms (input signal variation from -20% to +20% or from +20% to -20% of set value)   < 200 ms (delay < 0.1 s) < 200 ms (delay < 0.1 s)
<b>Indication for</b> Power supply ON Alarm ON  Output relays ON	LED, green LED, red (flashing 2 Hz during delay time) 2 x LED, yellow
<b>Environment</b> Degree of protection Pollution degree Operating temperature @ Max. voltage, 50 Hz @ Max. voltage, 50 Hz Storage temperature	(EN 60529) IP 20 3 (DPC01), 2 (PPC01) -20 to +60°C, R.H. < 95% -20 to +60°C, R.H. < 95% -30 to +80°C, R.H. < 95%
<b>Housing dimensions</b> DIN-rail versions Plug-in versions	45 x 80 x 99.5 mm 36 x 80 x 87 mm
<b>Weight</b>	Approx. 220 g
<b>Screw terminals</b> Tightening torque	(DPC01) Max. 0.5 Nm acc. to IEC 60947
<b>Approvals</b>	UL, CSA GL (DPC01 only)
<b>CE Marking</b>	Yes
<b>EMC</b> Immunity Emissions	Electromagnetic Compatibility According to EN 61000-6-2 According to EN 50081-1

**Asymmetry and tolerance monitoring:**

if one or more phase-phase or phase-neutral voltage exceed the set levels the red LED starts flashing 2 Hz and the respective output relay releases after the set time period. For both functions, if the phase sequence is wrong or one phase is lost, both output relays release immediately. Only 200 ms delay occurs. The failure is indicated by the red LED flashing 5 Hz during the alarm condition.

**Example 1**

(Mains monitoring - over and under phase-phase voltage) The relay monitors over and under voltage, phase loss and correct phase sequence.

**Example 2**


(Motor monitoring - starting and operating load -asymmetry and tolerance of phase-neutral voltage) DPC01 and PPC01 ensure correct starting and operating conditions. They monitor the voltage level, phase sequence (correct direction of the motor rotation) and asymmetry.

Frequent failures are fuse blowing and incorrect voltage level. In case of fuse blowing the motor regenerates a voltage in the interrupted phase. The relay detects the failure and reacts due to excessive imbalance among the phases.

## Function/Range/Level/Time Setting

Adjust the input range setting the DIP-switches 3 and 4. Select the desired function setting the DIP-switches 5 and 6 as shown on the left. To access the DIP-switches open the plastic cover using a screwdriver as shown below.

**Lower knobs:**  
Setting of delay on alarm time on absolute scale: 0.1 to 30 s.



**Centre knobs:**  
Setting of upper and lower level or setting of asymmetry and tolerance on relative scale.



**Power-ON delay**  
ON: 6 s ± 0.5 s  
OFF: 1 s ± 0.5 s

**Monitoring**  
ON: Phase-Neutral voltages  
OFF: Phase-Phase voltages

**Measuring range**


	ON	ON	OFF	OFF
SW3	ON	ON	OFF	OFF
SW4	ON	OFF	ON	OFF
M23 Ph-Ph Voltage	208 VAC	220 VAC	230 VAC	240 VAC
M48 Ph-Ph Voltage	380 VAC	400 VAC	415 VAC	480 VAC DPC01 only
M48 Ph-N Voltage	220 VAC	230 VAC	240 VAC	277 VAC DPC01 only
DPC01DM69 Ph-Ph Volt.	600 VAC	600 VAC	690 VAC	690 VAC
DPC01DM69 Ph-N Volt.	347 VAC	347 VAC	400 VAC	400 VAC

**Output**  
ON: 2 x SPDT relays  
OFF: 1 x DPDT relay



**Function**  
ON: Asymmetry and tolerance monitoring  
OFF: Over and undervoltage monitoring

## Operation Diagrams

Phase sequence, total phase loss

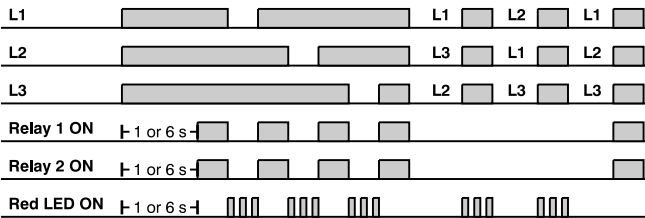


## Wiring Diagrams

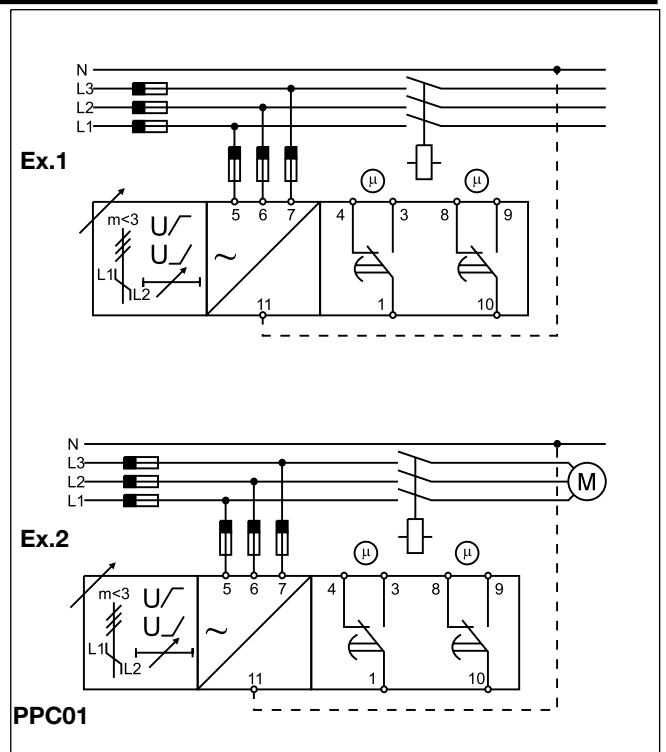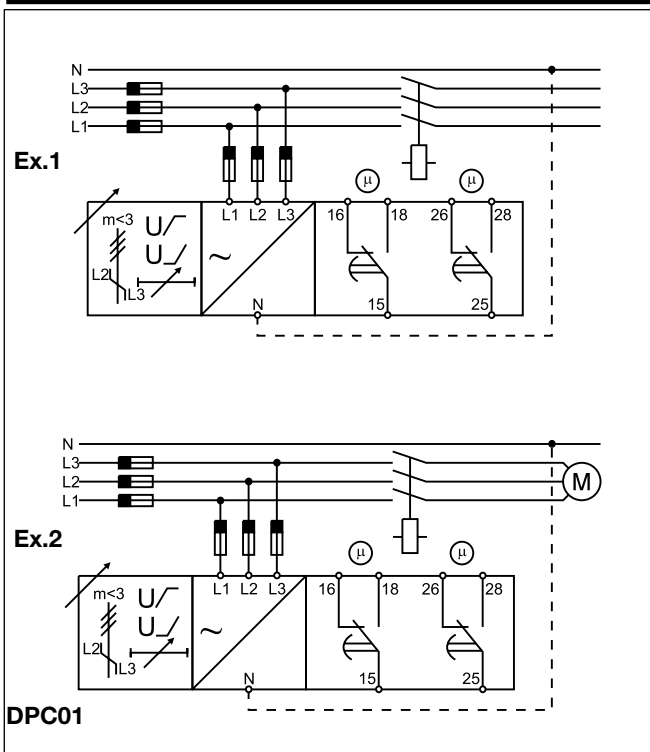



## Operation Diagrams (cont.)

### Over and undervoltage monitoring

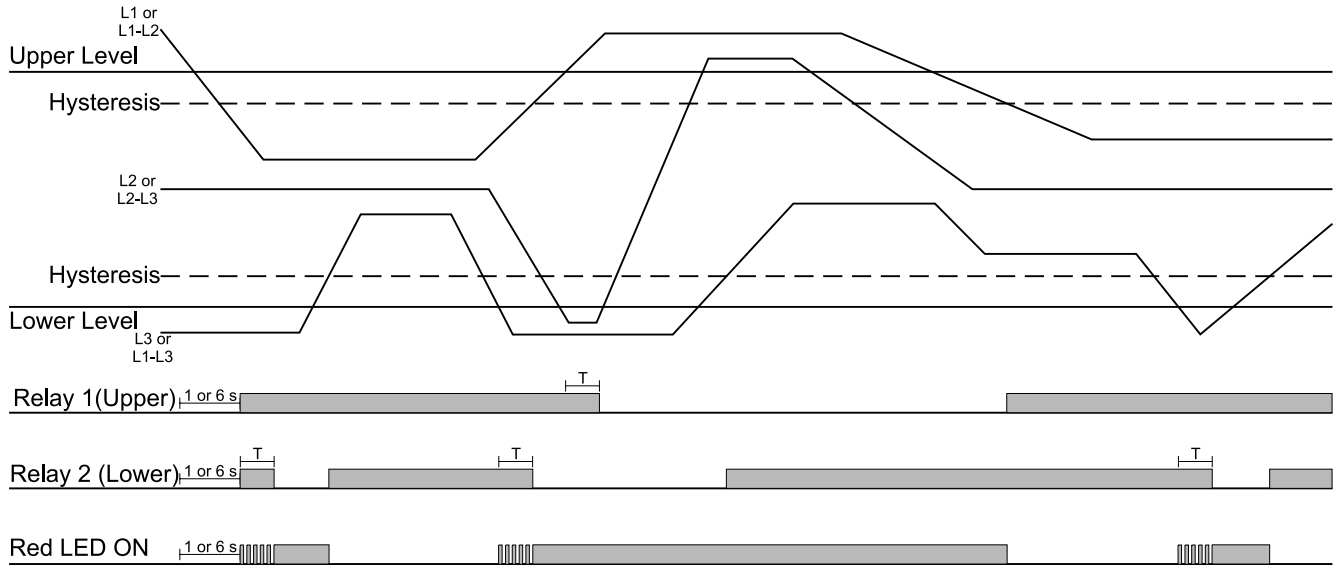

### Asymmetry and tolerance monitoring

